

1. OPERATION

The Vibra Switch "C" is a mechanical resonance system excited and kept in resonance by an electronic circuitry. The process liquid, when reaching the tines of vibration fork, modifies the vibration. The NIVOSWITCH can cover the majority of industrial liquid level detecting applications including installation in explosion hazardous area. Overfill or dry run protection as well as pump control is made possible with the versatile level switch.

Vibra Switch "C" Level Switch



2. TECHNICAL DATA

2.1 GENERAL DATA

| Vibra-Switch "C" | |
|------------------------------|--|
| Maximum pressure | 40 bar, 6 bar, for PP flange see derating diagrams |
| Probe length | 0.69 to 3 m |
| Material of the wetted parts | DIN 1.4571, Halar (ECTFE) coated |
| Liquid temperature range | see table in 5.1 and diagrams |
| Ambient temperature range | see table in 5.1 and diagrams |
| Liquid density | ≥ 0.7 kg/dm ³ |
| Liquid viscosity | ≤ 10000 mm ² /s (cSt) |
| Response time | When immersed: 0.5 sec When free: ≤ 1 s see response time diagram |
| Output mode indication | Bicolour (LED) |
| Operation test | Output can be changed by test magnet |

2.2 2-wire DC, NORMAL AND Ex APPROVED VERSION

| VERSION | 2-wire DC | |
|---|--|---|
| | Output 6 and 8 | Output 7 and 9 |
| Electric connections (wire cross section) | Connector | Integral cable (2 x 0.5 mm ²) |
| Ingress Protection | IP 65 | IP 68 |
| Output | DC current change: When free: 9 ± 1 mA; When immersed: 14 ± 1 mA | |
| Consumption | < 0.5 W | |
| Power supply (U) | 15 ... 27 V DC Provided by the PKK-312-8 Ex remote switching unit for the Ex version | |
| Setting operating mode | By switch on the remote switching unit (low fail-safe, high fail-safe) | |
| Electrical protection | Class III | |
| Ex protection mark | II 1 / 2 G EEx ia IIC T6 ... T4 | |
| Intrinsically safe data | U < 28 V, I < 100 mA P < 1.4 W, Ceq < 7 nF Leq = 0 For temperature classes see 5.1. | |



Klay Instruments b.v.
P.O. Box 13, 7990 AA Dwingeloo The Netherlands
Tel: (+31)521-591550, Fax: (+31)521-592046
E-mail: info@klay.nl

2.3 2-WIRE AC AND 3-WIRE DC VERSIONS, TO DRIVE RELAYS, PLC-S

| VERSION | 2 wire AC | | 3 wire DC | |
|---|----------------------------------|---|--|--|
| | Output 1 | Output 2 | Output 3 | Output 4 |
| Electric connections (wire cross section) | Connector | Integral cable (4 x 0.75 mm ²) max length 30 m | Connector | Integral cable (5 x 0.5 mm ²) max length 30 m |
| Mechanical protection | IP 65 | IP 68 | IP 65 | IP 68 |
| High/low mode setting | Connection within connector | Wire selectable | switch selectable | Wire selectable |
| Output | 2-wire AC, for serial connection | | Field selectable, PNP/NPN transistor switch | Field selectable, galvanically isolated PNP/NPN transistor switch |
| Output protection | — | | Reverse polarity, overcurrent and short circuit protection | |
| Supply voltage | 20 ... 255 V AC, 50/60 Hz | | 12 ... 55 V DC | |
| Consumption | Depending on load | | < 0.6 W | |
| Voltage drop in switched-on state | < 10.5 V | | < 4.5 V | |
| Electrical protection | Class I | | Class III | |
| Current load | max. continuous | 350 mA AC 13 | I _{max} = 350 mA DC / U _{max} = 55 V DC | |
| | min. continuous | 10 mA / 255 V, 25 mA / 24 V | — | |
| | max. impulse | 1.5 A / 40 ms | — | |
| Residual current (in switched off state) | < 6 mA | | < 100 µA | |

2.4. ACCESSORIES

- User's manual,
- Sealing ring (2mm thick Klingerit)
- Sliding sleeve for exten

2.5. ORDER CODES


VIBRA SWITCH C - - *

| VSC | CONNECTIONS | | LENGTH | | OUTPUT | |
|-----|-------------------------------|------|-------------------|---------|---------------------------------|------|
| | | CODE | | CODE | | CODE |
| | 1" BSP thread | S | SHORT (47 mm) | 47 | 2-wire AC with connector | 1 |
| | 1" NPT thread | N | Standard (100 mm) | 100 | 2-wire AC with cable | 2 |
| | Milkcoupling DN40 (DIN 11851) | M40 | 0.2 to 3 m | 02...30 | 3-wire PNP / NPN with connector | 3 |
| | Milkcoupling DN50 (DIN 11851) | M50 | | | 3-wire PNP / NPN with cable | 4 |
| | Tri clamp 2" | L2" | | | 2-wire DC with connector | 6 |
| | Flange (Specify size) | F | | | 2-wire DC with cable | 7 |
| | Other connection (specify) | X | | | 2-wire Ex with connector | 8 |
| | | | | | 2-wire Ex with cable | 9 |


* Ex version with Ex mark

* Flanged versions as standard come with flanges screwed on the 1" process connection.


2.6. DERATING DIAGRAMS

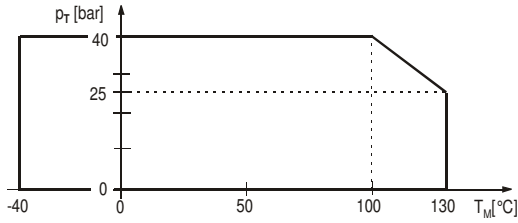


Pressure $[p_T]$ version $[T_M]$ for all models (except PP flanged)

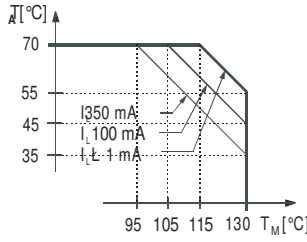

For 3-wire DC models $[I_L]$ load current

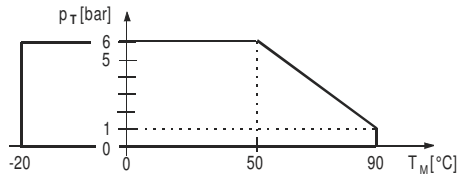


For models with Polypropylene flange p_T =process pressure
 T_M =medium temperature


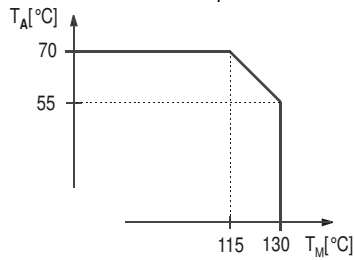


For 2-wire AC models $[T_A]$ ambient temperature $[T_M]$ medium temperature


2.7. RESPONSE TIME DIAGRAM WHEN GETTING FREE

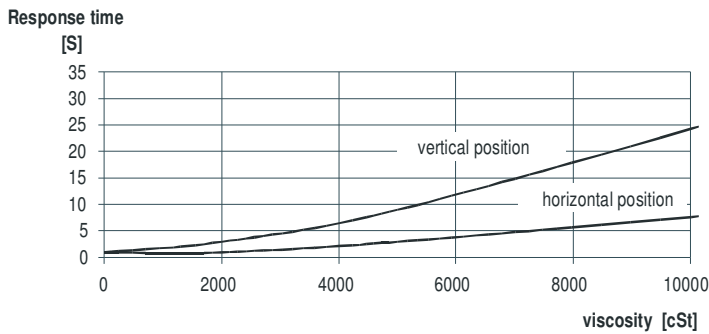

2.8 DIMENSIONS

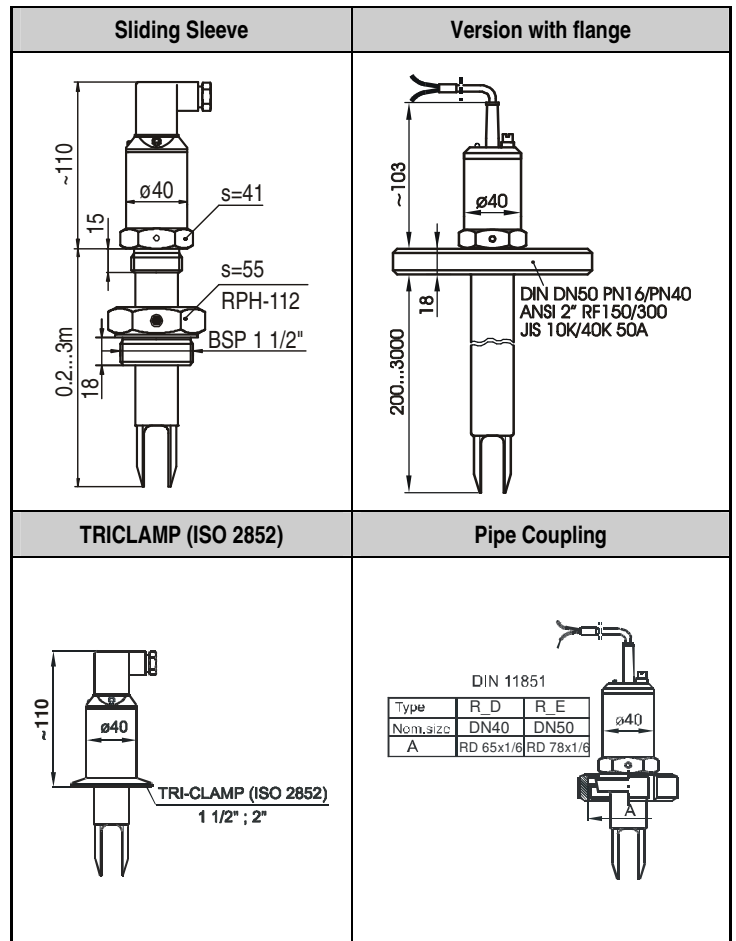
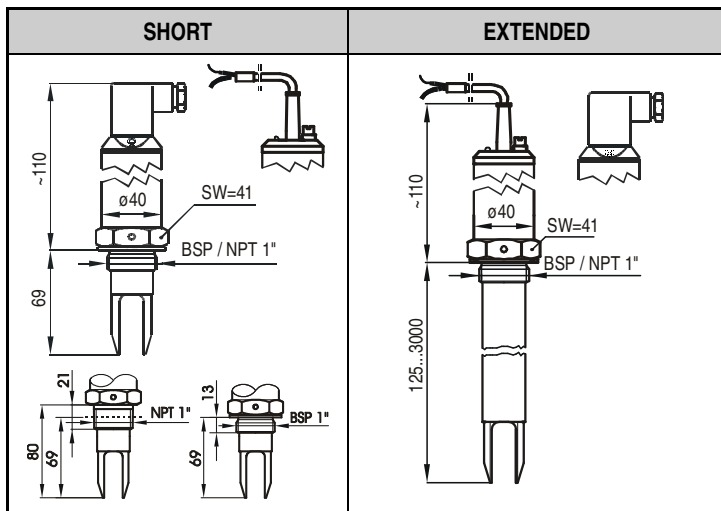


2.9 MATERIALS

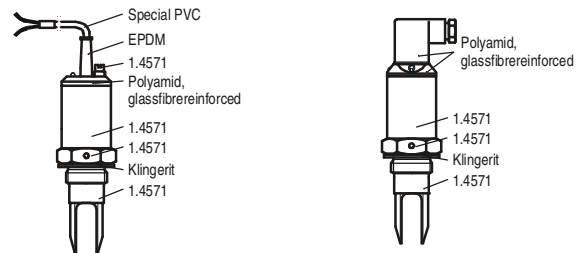


3. INSTALLATION

Prevent the device from any mechanical damage.

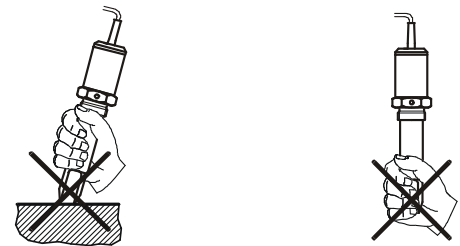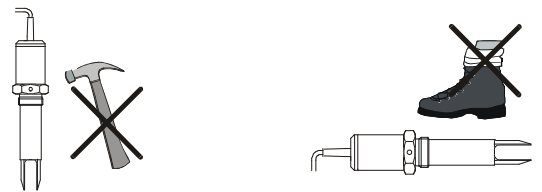


For positioning the fork-tines, use the marking on the hexagonal neck.



- Use a TEFLON (PTFE) tape to aid the positioning of the fork-tine
- If the fork-tine position is irrelevant, use the sealing ring provided

4.2.2.2. PLC applications (A-B sink input, OMRON SYSMAC...)

PNP mode

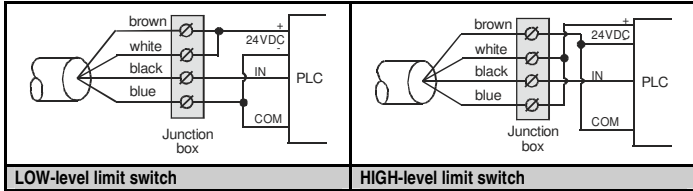


4.3. 2 wire DC versions

STANDARD OR EX


4.3.1. Connector version

Output 6
Output 8 Ex

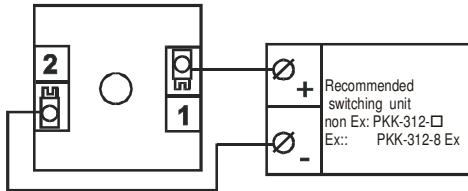

4.3.2. Integral cable version

Output 7
Output 9 Ex

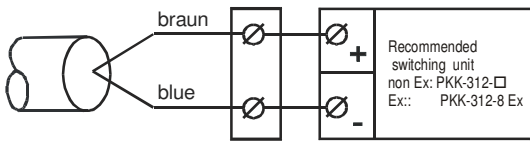

5. ADJUSTMENT

Check connecting of the wires and position of the mode of operation switch (if there is). After connection and power up the tuning fork is operational. Operating diagram of the Vibra Switch (except 2-wire DC versions)

| Power supply | Fork | Operating mode | LED | Output |
|--------------|------------------|-------------------------|---------|--------|
| ON | Immersed | HIGH-level limit switch | RED | OFF |
| | | LOW-level limit switch | GREEN | ON |
| | Free | HIGH-level limit switch | GREEN | ON |
| | | LOW-level limit switch | RED | OFF |
| FAILS | Free or immersed | HIGH or LOW | NOT LIT | OFF |

Operating diagram of the 2-wire DC version


| Fork | LED | Output |
|----------|-------|-----------|
| Immersed | RED | 14 ± 1 mA |
| Free | GREEN | 9 ± 1 mA |

5.1. APPLYING Ex APPROVED MODELS

Applying Ex approved models take into consideration the table of allowed temperatures listed below

| Temperature classification | T6 | T5 | T4 |
|----------------------------|-------|-------|-------|
| T _{Ambient} | 60 °C | 70 °C | 60 °C |
| T _{Medium} | 80 °C | 70 °C | 95 °C |

Table of possible temperatures

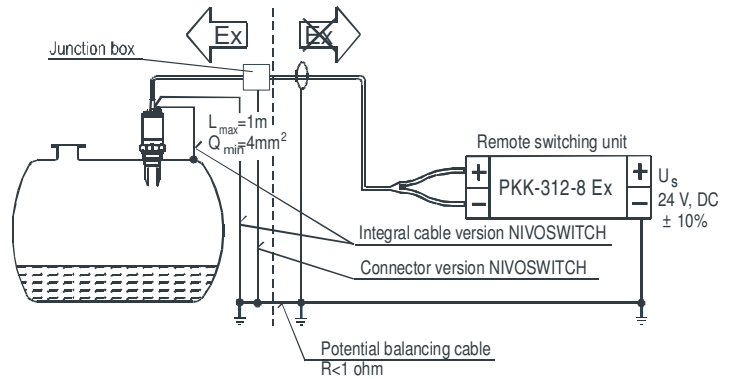

CONDITIONS OF SAFE OPERATION

- The vibration fork level switch has to be supplied by a certified intrinsically safe circuit with maximum parameters only:
 $U_0 = 28 \text{ V}$
 $I_0 = 100 \text{ mA}$
 $P_0 = 1.4 \text{ W}$
- For installation of version output 9 with integrated cable, there has to be a suitable connection box near the level switch.
- It is allowed for the vibration fork to get in contact with the liquid only; the installation has to guarantee that the housing (head) is outside the liquid.
- The level switch has to be connected to the local equipotential bonding.
- To avoid electrostatic ignition danger, the coated version type Ex is allowed for substances with explosion group IIA or IIE only.

6. MAINTENANCE, REPAIR

The Vibra Switch C™ does not require routine maintenance. In some instances, however, the sensor probe may need occasional cleaning to remove surface deposits. This must be carried out gently, without harming the vibrating section of the vibrating fork.



7. STORAGE CONDITIONS

Ambient temperature: -35 to +60 °C
 Relative humidity: max. 98 %

8. WARRANTY

All Klay products are warranted to be free from defects in material or workmanship for a period of one year from date of delivery.

Repairs under guarantee are carried out at the Manufacturers premises. The purchaser is liable for costs of dismantling and re-installation as well as transport costs.

Klay shall not be liable for misapplication, labour claims, direct or consequential damage or expense arising from the installation or use of equipment.

April, 2004

Klay Instruments reserves the right to change technical specifications without notice.